

Product Description

RD052/RD053 SSP and RD054/RD055 SSU are Standard/Quick Response frangible glass bulb automatic sprinklers. They are FM approved and UL listed, standard orifice fire sprinklers for installation in fire sprinkler systems. Sprinklers produce a hemispherical water distribution pattern below the deflector. In a fire condition the heat causes the fluid in the glass bulb to expand which shatters the glass and releases the spring seal assembly. Water flows from the orifice onto the sprinkler deflector which diffuses the water into a uniform spray pattern which extinguishes or controls the fire.

Standard Response

RD052 Pendent
RD054 Upright

Quick Response


RD053 Pendent
RD055 Upright

Operating Temperatures

Nominal Operating Temperature	Bulb Colour
57°C (135°F)	Orange
68°C (155°F)	Red
79°C (175°F)	Yellow
93°C (200°F)	Green
141°C (286°F)	Blue

Technical Details

K factor	K115 (K8.0)
Thread size	1/2" NPT, R1/2 (1/2" BSPT) available on special order
Max. Working Pressure	12 bar (175 psi)
Min. Operating Pressure	0.5 bar (7psi)
Factory Pressure Test	34 bar (500 psi)
Weight	59 g (2.1 oz)
Fitted with Bulb Protector	Remove after installing sprinkler

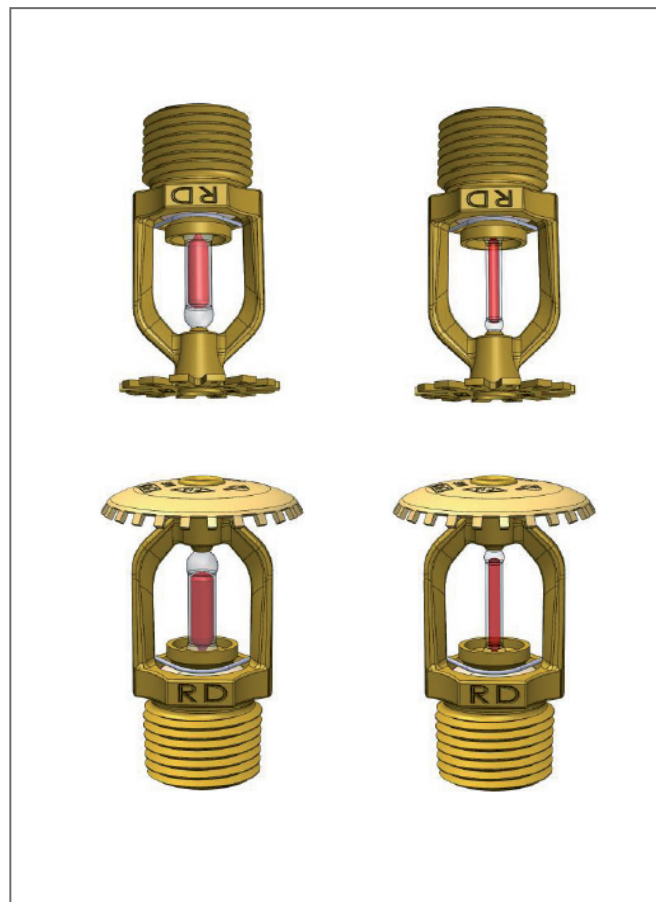

A01

Manufacturer: Rapidrop

Standard Finishes

Plain (Natural)
Chrome
White - Epoxy Powder Polyester
Other RAL colours, available on request.

Accessories


Baffle plat
Sprinkler Guard
Sprinkler Wrench



Design Coverage


For sprinkler coverage area and placement refer to NFPA 13 standards or other Installation rules for automatic sprinkler systems as required by the authority having jurisdiction. The following details are provided for information only.

A01

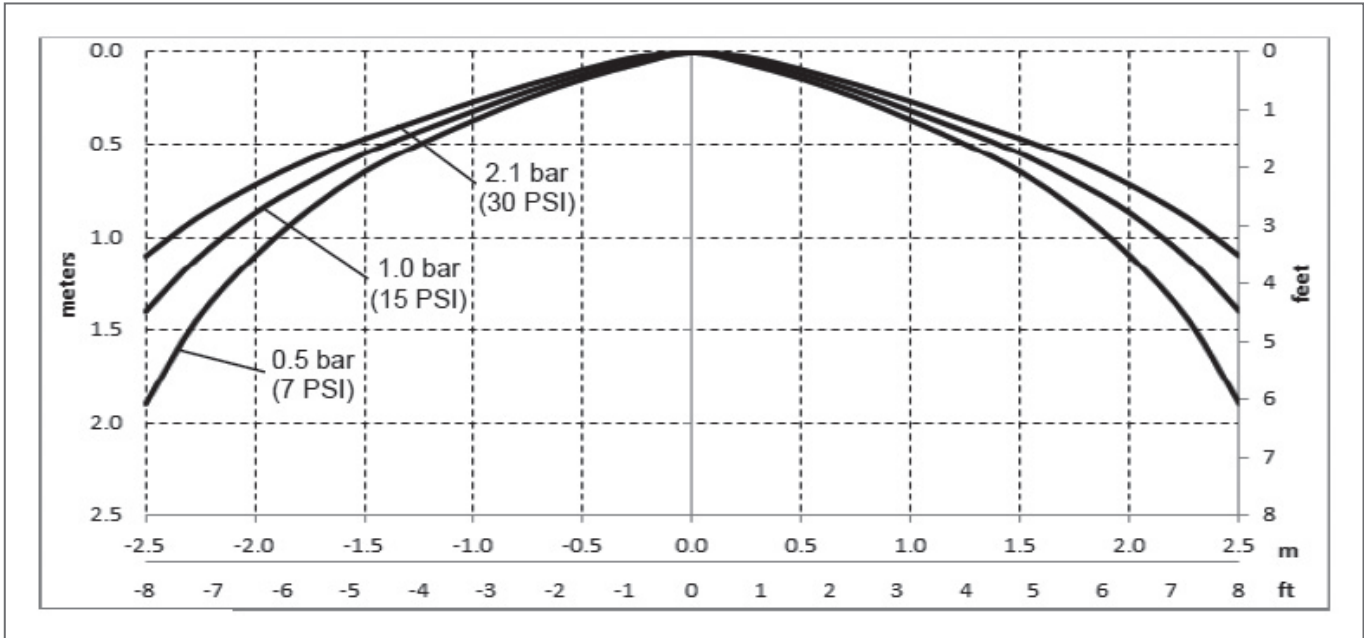

RD052, RD053
Spray Pendent Sprinkler
For installing only in pendent position giving hemispherical discharge below the deflector with little or no water being discharged upwards.

RD054, RD055
Spray Upright Sprinkler
For installing only in upright position giving hemispherical discharge below the deflector with little or no water being discharged upwards.

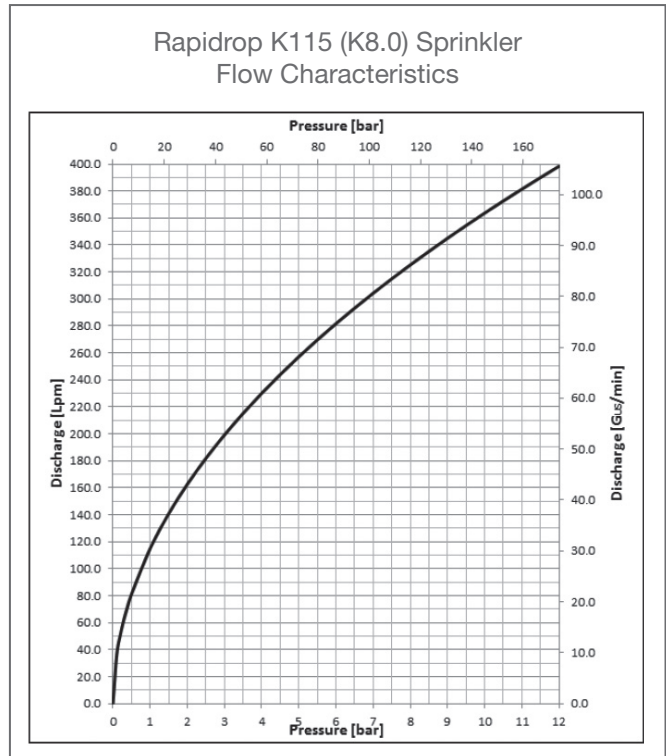

Installation

1. All sprinklers must be installed and maintained in compliance with this document and according to the installation standards or local rules and requirements which are specified by the authority having jurisdiction. It is the installer's responsibility to conform to such standards and requirements, deviations from the requirements will void any warranty.
2. To ensure that the minimum flow requirement is met, the system piping must be correctly sized.
3. To avoid mechanical damage the sprinklers must be installed after the piping is in place. Any damaged sprinklers must be replaced. If there is a leak from the sprinkler thread, remove the sprinkler, apply new pipe joint compound or tape and re-install.
4. Always check that the sprinklers are the correct model, style, orifice size, temperature and sensitivity ratings prior to commencing installation.
5. Upright sprinklers must be mounted in upright position and Pendent sprinklers must be mounted in pendent position.
6. Use only non-hardening pipe joint compound or PTFE tape. Apply to external threads only.
7. Hand tighten the sprinkler into the fitting, then use the correct sprinkler wrench to tighten the sprinkler into the fitting. Ensure that the sprinkler wrench stays on the wrench flats while tightening the sprinkler. A leak tight joint requires only 10 to 19 Nm (7 to 14 ft.lbs.) torque. i.e. a tangential force of 6.35 to 12.7kgs. (14 to 28 lbs.) delivered through a 150mm (6") handle will deliver adequate torque. Torque levels over 29 Nm (21 ft.lbs.) may distort the orifice seal and result in a leakage.
8. Remove sprinkler bulb protector after the sprinkler is installed and before the system is put into service.

Care and Maintenance

Sprinklers must be carefully handled and stored where temperatures will not exceed 100°F/38°C and they must never be painted, plated, coated or otherwise modified after leaving the factory.

Do not install sprinklers which have been dropped or damaged in any way. The installation rules required by the authority having jurisdiction contain guidelines on minimum inspection and maintenance requirements to assist owners fulfilling their responsibility to ensure sprinklers and sprinkler systems are maintained in proper operating condition.

Warranty

Warranty period is one year from the date of shipment. For full details please refer to our terms and conditions of sale.

Ordering Information

Specify: model, orifice size, operating temperature, response type, finish and approval listing required

A01

Sprinkler Spanner



Always use sprinkler spanner for installing the sprinklers.
art number: RDSPKSPANV2



NOTA GENERALE:

L'attrezzatura presentata in questo bollettino deve essere installata in conformità agli ultimi standard pubblicati dalle Norme UNI EN 12845, National Fire Protection Association, Factory Mutual Research Corporation o altre organizzazioni simili e anche con le disposizioni dei codici governativi o delle ordinanze laddove applicabili.
Con la presente pagina tecnica, MEFA Italia intende fornire pertinenti informazioni tecniche, aggiornandole periodicamente.
MEFA Italia non si ritiene responsabile in caso di errori di stampa o informazioni inesatte in quanto le stesse possono variare senza preavviso.
The equipment presented in this bulletin is to be installed in accordance with the latest published Standards of the UNI EN 12845, National Fire Protection Association, Factory Mutual Research Corporation, or other similar organizations and also with the provisions of governmental codes or ordinances whenever applicable.
With this technical page, MEFA Italia intends to provide relevant technical information, updating them periodically.
MEFA Italia is not responsible for any inaccurate print or inaccurate information as these may vary without prior notice.

NOTA EUROFIRE:

Eurofire è un marchio registrato da MEFA Italia per la presentazione di tutti i prodotti della linea Antincendio.
I fornitori dei prodotti Eurofire vengono rigorosamente selezionati nel rispetto della qualità e delle caratteristiche distintive descritte in questo documento tecnico.
I fornitori dei prodotti potrebbero variare senza preavviso, ma sempre nel rispetto delle caratteristiche qui descritte.
Eurofire is a registered trademark of MEFA Italia for the presentation of all products of the Fire Protection Line.
The suppliers of Eurofire products are strictly selected in compliance with the quality and distinctive features described in this technical document.
Product providers may vary without notice, but always respecting the features described herein.